


QF 75 (5 pin Plug base) Instruction manual

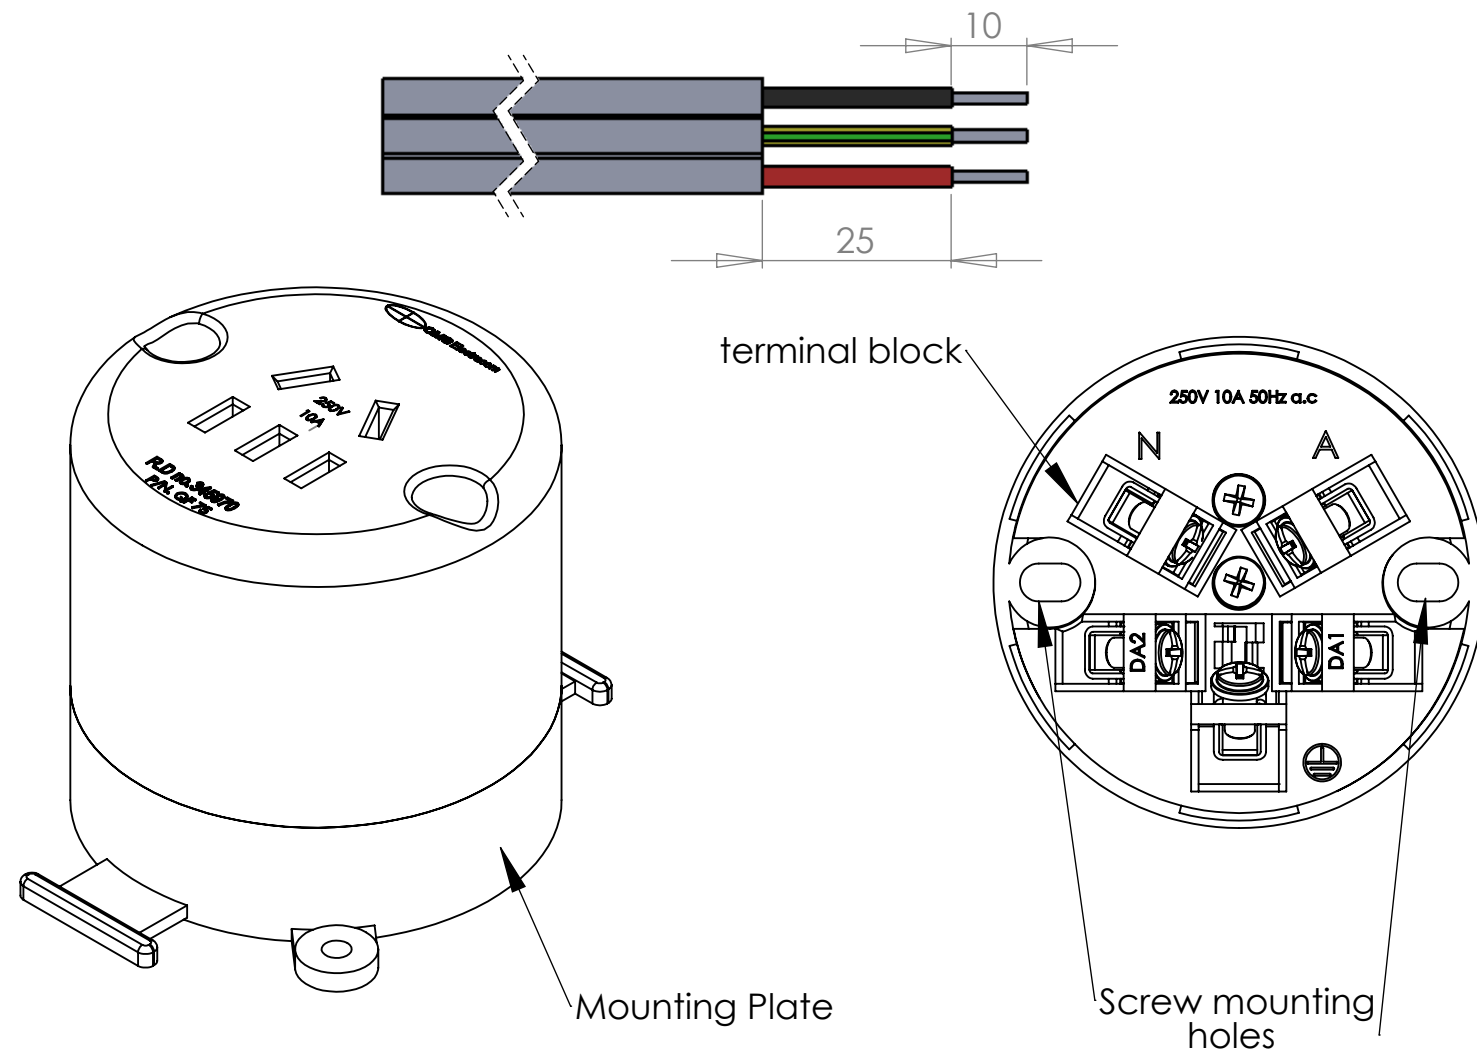

- 1/ Strip Cable to recommended length.
- 2/ Terminate cable wiring into terminal blocks, ensure correct polarity, use break-out areas in socket body to allow cable entry and exit.
- 3/ Mount unit using screw mounting holes onto industry standard conduit mounting block or use mounting plate provided.

Rating - 10A 250V a.c

Conductor range - 1.0mm² to 2.5mm² solid/stranded to AS/NZS5000

This product must be installed by a qualified electrician.
Disconnect power supply before connecting or disconnecting this product.
Active contacts rated low voltage max. 10Amps